

PRESSURE TRANSMITTER

DATA SHEET

FKG...5

The FKG model of the FCX-AII V5 series of pressure transmitters accurately measures gauge pressure and transmits a proportional 4-20 mA output signal.

The transmitter uses an unique micro-capacitive silicon sensor in combination with a state-of-the-art digital signal processing to provide exceptional performances in terms of accuracy and stability.

FEATURES

1. High accuracy up to $\pm 0.04\%$

Fuji Electric's micro-capacitive silicon sensor provides in standard $\pm 0.065\%$ accuracy for all elevated or suppressed calibration ranges without additional adjustments.

$\pm 0.04\%$ accuracy is available in option.

2. Minimum inventory and design

Electronics unit, local indicators and electronics housing are interchangeable among all FCX-AII V5 transmitters.

3. Minimum environmental influence

The Advanced Floating Cell technology provides a high immunity against temperature variations and overpressure commonly found in the process industry and substantially reduces the overall measurement error.

4. HART/Fuji Electric communication protocols

FCX-AII V5 series of pressure transmitters can communicate using either the universal HART or the proprietary and faster Fuji Electric communication protocol.

By the use of Device Description files, HART compatible devices can communicate with any FCX-AII V5 transmitter.

5. Application flexibility

Various options are available to address most of the process industry applications, including :

- Full range of hazardous area approvals
- Built-in RFI filter and lightning arrester
- Analog or 5 digits local display with engineering units
- Stainless steel electronics housing
- Wide selection of wetted part materials

6. Programmable output Linearization Function

The output signal can be linearized using up to 14 pair-points.

7. Burnout current flexibility

The burnout current value can be adjusted in the ranges of [3.2 ; 4.0] and [20.0 ; 22.5] mA and can be compliant with NAMUR NE43 recommendations.



FUNCTIONAL SPECIFICATIONS

Type :

FKG : Smart, 4-20mA + HART/Fuji Electric communication protocols.

Service :

Liquid, gas, or vapour

Span, range and overrange limit :

| Model | Span limit [kPa] {bar} | | Range limit [kPa] {bar} | | Overrange limit [MPa] {bar} |
|--------|---------------------------|----------------|----------------------------|----------------|-----------------------------------|
| | Min. | Max. | Lower limit | Upper limit | |
| FKG□01 | 1.3 {0.013} | 130 {1.3} | -100 {-1} | 130 {1.3} | 1 {10} |
| FKG□02 | 5 {0.05} | 500 {5} | -100 {-1} | 500 {5} | 1.5 {15} |
| FKG□03 | 30 {0.3} | 3000 {30} | -100 {-1} | 3000 {30} | 9 {90} |
| FKG□04 | 100 {1} | 10000 {100} | -100 {-1} | 10000 {100} | 15 {150} |
| FKG□05 | 500 {5} | 50000 {500} | -100 {-1} | 50000 {500} | 75 {750} |

Remark :

To minimize environmental influence, span should be greater than 1/40 of the max. span in most applications.

Lower range limit : (vacuum limit)

Silicone fill sensor : see fig.1

Fluorinated fill sensor :

66kPa abs (500 mmHg abs) at below 60°C

Output signal :

4-20 mA with digital signal superimposed on the analog signal.


Power supply :

10.5 to 45 V DC at transmitter terminals.

10.5 to 32 V DC with the optional arrester.

Refer to hazardous location table for specific limitations

Load limitations : see figure below

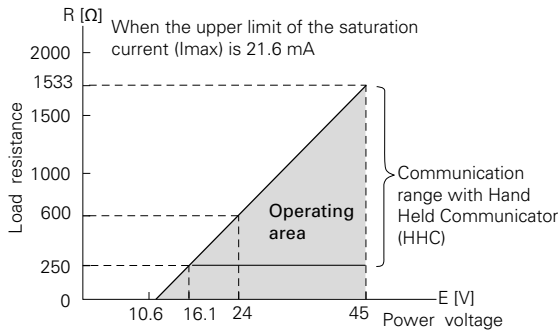

Note 1 : The load resistance varies with the upper limit of the saturation current (I_{max})

$$R [\Omega] = \frac{E [V] - 10.5}{(I_{max} [mA] + 0.9) \times 10^{-3}}$$

Note 2 : For communication with HHC (FXW model), a minimum load of 250 Ω is required.

Hazardous locations :

| Marking (Digit 10 =) | Protection type |
|----------------------|---|
| ATEX | Intrinsic Safety "i" : |
| | Ex II 1G/D |
| | Ex ia IIC T4 Ga (-40°C ≤ Ta ≤ +70°C) |
| | Ex ia IIC T5 Ga (-40°C ≤ Ta ≤ +50°C) |
| | Ex ia IIIC T135°C Da (-40°C ≤ Ta ≤ +70°C) |
| | Ex ia IIIC T100°C Da (-40°C ≤ Ta ≤ +50°C) |
| | IP 66/67 |
| | Electrical Parameters : |
| | Ui ≤ 28 Vdc, Ii ≤ 94.3 mA, Pi ≤ 0.66 W |
| | Ci = 26 nF(1) / 36 nF(2), Li = 0.6 mH(3) / 0.7mH(4) |
| | Flameproof Enclosure "d" : |
| | Ex II 2G/D |
| | Ex d IIC T5 Gb (-40°C ≤ Ta ≤ +85°C) |
| | Ex d IIC T6 Gb (-40°C ≤ Ta ≤ +65°C) |
| | Ex tb IIIC T100°C Db (-40°C ≤ Ta ≤ +85°C) |
| | Ex tb IIIC T85°C Db (-40°C ≤ Ta ≤ +65°C) |
| | 45 Vdc max |
| | Increased Safety "e" : |
| | Ex II 3G/D |
| | Ex ec IIC T5 Gc (-40°C ≤ Ta ≤ +70°C) |
| | Ex tc IIIC T100°C Dc (-40°C ≤ Ta ≤ +70°C) |
| | 45 Vdc max |
| | Combination (K) + (X) |
| IECEX | Intrinsic Safety "i" : |
| | Ex ia IIC T4 Ga (-40°C ≤ Ta ≤ +70°C) |
| | Ex ia IIC T5 Ga (-40°C ≤ Ta ≤ +50°C) |
| | Ex ia IIIC T135°C Da (-40°C ≤ Ta ≤ +70°C) |
| | Ex ia IIIC T100°C Da (-40°C ≤ Ta ≤ +50°C) |
| | IP 66/67 |
| | Electrical Parameters : |
| | Ui ≤ 28 Vdc, Ii ≤ 94.3 mA, Pi ≤ 0.66 W |
| | Ci = 26 nF(1) / 36 nF(2), Li = 0.6 mH(3) / 0.7mH(4) |
| | Flameproof Enclosure "d" : |
| | Ex d IIC T5 Gb (-40°C ≤ Ta ≤ +85°C) |
| | Ex d IIC T6 Gb (-40°C ≤ Ta ≤ +65°C) |
| | Ex tb IIIC T100°C Db (-40°C ≤ Ta ≤ +85°C) |
| | Ex tb IIIC T85°C Db (-40°C ≤ Ta ≤ +65°C) |
| | 45 Vdc max |
| | Increased Safety "e" : |
| | Ex ec IIC T5 Gc (-40°C ≤ Ta ≤ +70°C) |
| | Ex tc IIIC T100°C Dc (-40°C ≤ Ta ≤ +70°C) |
| | 45 Vdc max |
| | Combination (T) + (R) |

| | | |
|--------|-----|---|
| cCSAus | (J) | Intrinsic safety / Non Incendive / Class 1 Division 2 : |
| | | IS Class I Division 1, Groups ABCD Ex ia |
| | | Class II Groups EFG; Class III |
| | | NI Class I Division 2, Groups ABCD |
| | | (Per control drawing TC522873) |
| | (E) | Class I Division 2, Groups ABCD |
| | | T4 (-40°C ≤ Ta ≤ +70°C) |
| | | T5 (-40°C ≤ Ta ≤ +50°C) |
| | | Ui ≤ 28 Vdc, Ii ≤ 94.3 mA, Pi ≤ 0.66 W |
| | | Ci = 26 nF(1) / 36 nF(2), Li = 0.6 mH(3) / 0.7mH(4) |
| | (L) | Explosion proof |
| | | XP Class I Division 1, Groups CD |
| | | Class II Groups EFG; Class III |
| | | T5 (-40°C ≤ Ta ≤ +85°C) |
| | | T6 (-40°C ≤ Ta ≤ +65°C) |
| ATEX | (W) | Vmax = 42.4 Vdc |
| | | Combination (J) + (E) |
| IECEX | (W) | Combination (K) + (X) + (T) + (R) + (J) + (E) |
| | | |

(1) Without optional arrester

(2) With optional arrester

(3) Without analog indicator

(4) With analog indicator

Configuration :

Configuration of the FCX-All V5 series of pressure transmitters can be carried out by either using a Hand Held Communicator (ie. Fuji Electric FXW or third party HART terminal) or the 3 push-buttons optional indicator.

A third party HART hand held communicator can be used in combination with Fuji Electric FCX-All V5 HART Device Description files (<https://fieldcommgroup.org>).

| Functions | Fuji Electric FXW | | Third party HART HHC | | 3 push buttons optional indicator | |
|-------------------------------|-------------------|-----|----------------------|-----|-----------------------------------|-----|
| | Display | Set | Display | Set | Display | Set |
| Tag Nb | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| Model Nb | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| Serial Nb & Software revision | ✓ | — | ✓ | — | ✓ | — |
| Engineering units | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| Upper Range Value | ✓ | — | ✓ | — | ✓ | — |
| Measuring Range | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| Damping | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| Output signal type | Linear | ✓ | ✓ | ✓ | ✓ | ✓ |
| | Square Root | ✓ | ✓ | ✓ | ✓ | ✓ |
| Burnout current | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| Calibration | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| Output Adjust | — | ✓ | — | ✓ | — | ✓ |
| Measuring Value | ✓ | — | ✓ | — | ✓ | — |
| Self Diagnosis | ✓ | — | ✓ | — | ✓ | — |
| Printer (option) | ✓ | — | ✓ | — | ✓ | — |
| External Adj Screw Lock | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| Transmitter Display | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| Linearization | — | — | ✓ | ✓ | ✓ | ✓ |
| Rerange | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| Saturation Current | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| Write Protect | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| History | — | — | — | — | — | — |
| | — | — | — | — | — | — |
| — Calibration History | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| — Ambient T° History | ✓ | — | ✓ | — | ✓ | — |

Note 1 : The FXW firmware revision must be higher than 7.0 in order to address FCX-All V5 "Saturation Current", "Write Protect" and "History" functions.

Note 2 : The "Linearization" function is not accessible throught the 3 puh-buttons optional indicator.

Zero and span adjustment :

Zero and span are adjustable with a Hand Held Communicator or locally with the external adjustment screw.

Damping :

The damping time constant can be adjusted within the range of [0.06 to 32] seconds.

Zero elevation/suppression :

Zero can be adjusted within the range of -1 bar to +100% of the URL of the sensor.

Normal/reverse action :

Selectable from a Hand Held Communicator.

Local indicator :

One optional analog or 5-digits digital indicator.

Burnout direction and saturation currents :

If the self-diagnostic functions detect a transmitter a failure, the burnout function will drive the output signal to either "Output Hold", "Output Overscale" or "Output Underscale" modes.

When "Output Hold" :

The output signal is held as the last value just before the failure happens.


When "Output Overscale" :

The output signal is set within the range of [20.0 to 22.5] mA

When "Output Underscale" :

The output signal is set within the range of [3.2 to 4.0] mA

Both burnout and saturation current can be adjusted within the range of [3.2 ; 4.0] and [20.0 ; 22.5] mA

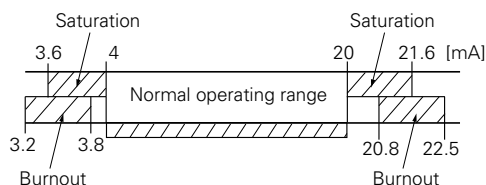**Loop-check / fixed output current :**

The transmitter can be configured to provide a constant output signal from 3.2 up to 22.5 mA.

Temperature limit :

Ambient :

- 40 to +85°C
- 20 to +80°C (with optional LCD unit)
- 40 to +60°C (with optional arrester)

Please refer to the hazardous locations table for ambient temperature limitations according to the standard and type of protection.

Process :

- 40 to +100°C for silicone fill sensor
- 20 to +80°C for fluorinated oil fill sensor

Storage :

- 40 to +90°C

Humidity limit :

0 to 100% RH (Relative Humidity)

Temperature effect :

Effects per 28°C change between the limits of - 40°C and +85°C

Zero shift :

$$\pm (0.075 + 0.0125 \frac{\text{URL}}{\text{span}}) \%$$

Total effect :

$$\pm (0.095 + 0.0125 \frac{\text{URL}}{\text{span}}) \%$$

Double the effects for material code (7th digit in model code) "H", "M", "T"

Overrange effect :

Zero shift :

0.2% of URL for any overrange to maximum limit
(< overrange max. admissible)

Supply voltage effect :

Less than 0.005% of calibrated span per 1 V

Update rate :

60 msec

RFI effect :

< 0.2% of the URL for the frequencies from 20 up to 1000 MHz with an electrical field strength of 10 V/m and housing covers in place. (Classification : 2-abc : 0.2% of span according SAMA PMC 33.1).

Response time : (63.3% of output signal without damping)

Time constant :

0.08 sec (at 23°C)

Dead time :

Approximately 0.12 sec

Response time = time constant + dead time

Mounting position effect :

Zero shift :

Less than 0.12 kPa {1.2 m bar} for a 10° tilt in any position. This error can be corrected by adjusting zero.
(Double the effect for fluorinated filling fluid).

No effect on span.

Vibration effect :

< ±0.25% Of spans for spans greater than 1/10 of URL.

Frequency 10 to 150 Hz, acceleration 39.2 m/sec²

Material fatigue :

Please consult Fuji Electric.

Dielectric strength :

500 V AC, 50/60Hz 1 min., between circuit and earth
(except with the optional arrester)

Insulation resistance :

More than 100 MΩ at 500 V DC.

Internal resistance for external field indicator :

12 Ω max (connected to test terminal CK+ and CK-)

Pressure equipment directive (PED) 97/23/EC

Digit 6 code 1, 2, 3, 4 and 9 according to Article 4.3

Digit 6 code 5 : Category III Model H1

PERFORMANCE SPECIFICATIONS

Reference conditions, silicone oil filling, SS 316 isolating diaphragms, 4-20 mA analog output.

Accuracy rating : (including linearity, hysteresis, and repeatability)

For models up to 10000 kPa :

For spans > 1/10 of URL :

- ± 0.065% (standard) of span or
- ± 0.04% (option) of span

For < 1/10 of URL :

$$\pm (0.015 + 0.005 \frac{\text{URL}}{\text{Span}}) \%$$

For 50000 kPa model :

For spans > 1/10 of URL :

- ±0.1% of span

For spans < 1/10 of URL :

$$\pm (0.05 + 0.005 \frac{\text{URL}}{\text{Span}}) \%$$

Stability :

±0.1% of upper range limit (URL) for 10 years.

PHYSICAL SPECIFICATIONS

Conduit connections :

1/2"-14 NPT, Pg13.5, or M20×1.5

Process connections :

Standard :

1/4"-18 NPT

Option :

1/2"-14 NPT with oval flanges.

Remark : the codification doesn't include the oval flange accessories.

Process-wetted parts material :

| Material code (7th digit in the model code) | Process cover | Diaphragm | Wetted sensor body | Vent/drain |
|---|------------------|------------------------|--------------------------|------------|
| V | SS 316L | SS 316L | SS 316L | SS 316L |
| W | SS 316L | Hastelloy-C | SS 316L | SS 316L |
| J | SS 316L | SS 316L +Au coating | SS 316L | SS 316L |
| H | SS 316L | Hastelloy-C | Hastelloy-C | SS 316L |
| M | SS 316L | Monel | Monel lining | SS 316L |
| T | SS 316L | Tantalum | Tantalum lining | SS 316L |

Remark :

Gasket : Viton o-ring or PTFE square section gasket.

Availability of above material design depends on ranges and static pressure.

Refer to "Model codes".

Non-wetted parts material :

Electronics housing :

Low copper die-cast aluminum alloy finished with polyester coating (standard) or SS 316 (option)

Bolts and nuts :

Standard :

Cr-Mo alloy

Option :

SS 316 (L) or SS 660 for 50 MPa unit

Filling fluid :

Standard :

Silicone oil

Option :

Fluorinated oil

Mounting bracket :

SS 304L or 316L (option)

Environmental protection :

IEC IP66/IP67 and Type 4X

Mounting :

Without mounting bracket :

Direct mounting

With optional mounting bracket :

For 50 mm (2") pipe or direct wall mounting.

Mass {weight} :

Transmitter : 2.9 to 3.4 kg without options.

Add : 0.3 kg for indicator

0.5 kg for mounting bracket

2 kg for stainless steel housing (option)

OPTIONAL FEATURES

Local indicator :

A plug-in analog indicator (2.5% accuracy) can be mounted into the electronics compartment or the terminal box of the housing.

An optional 5 digit indicator with engineering units is also available.

Local configuration with the 3 push-buttons indicator :

A local configuration can be carried out with the optional 3 push-buttons 5-digits indicator.

Arrester :

A built-in arrester protects the electronics from lightning surges.

Lightning surge immunity :

±4 kV (1.2 × 50 μs)

Oxygen service :

Special cleaning procedures are applied during the manufacturing process to maintain oil free all process wetted part. The filling fluid is fluorinated oil.

Chlorine service :

Same procedures and filling fluid as for oxygen service.

Degreasing :

Process-wetted parts are cleaned and the filling fluid is standard silicone oil. Not for use with oxygen or chlorine presence.

NACE specification :

Metallic materials for all pressure boundary parts comply with NACE MR 0175/ISO 15156.

SS 660 or SS 660/660 bolts and nuts comply with NACE MR 0175/ISO 15156.

Optional tag plate :

An extra stainless steel tag plate with customer tag data is wired to the transmitter.

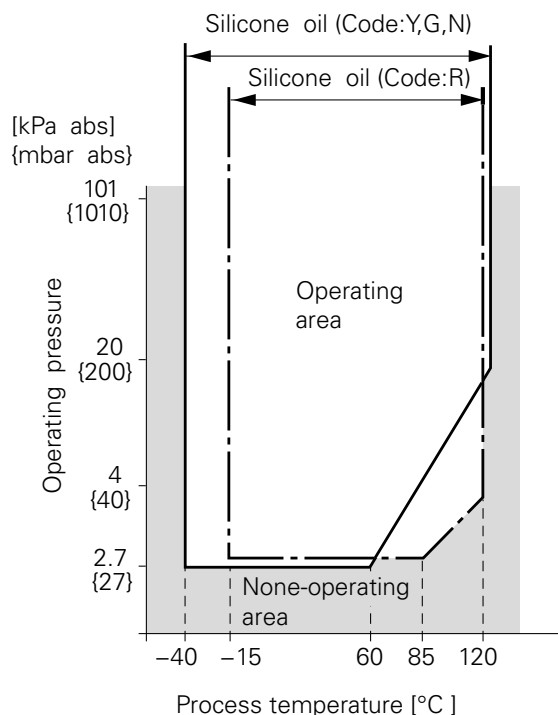


Fig.1

Relation between process temperature and operating pressure

ACCESSORIES

Oval flanges :

Converts process connection to 1/2"-14 NPT.

Hand Held Communicator :

FXW Model, refer to datasheet n° EDS8-47

MODEL CODE SYMBOLS

| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | |
|---|---|---|---|---|---|---|---|---|----|----|----|----|----|----|----|--|
| F | K | G | | | | | 5 | | | | | | | | | DESCRIPTION |
| | | | | | | | | | | | | | | | | Type |
| | | | | | | | | | | | | | | | | Gauge pressure - Smart, 4-20 mA + HART/Fuji Electric communication protocols |
| | | | | | | | | | | | | | | | | Connections |
| | | | | | | | | | | | | | | | | Process connection |
| | | | | | | | | | | | | | | | | Oval flange threading |
| | | | | | | | | | | | | | | | | Conduit connection |
| | | | | | | | | | | | | | | | | Enclosure type |
| R | | | | | | | | | | | | | | | | "L" shape |
| T | | | | | | | | | | | | | | | | |
| V | | | | | | | | | | | | | | | | |
| W | | | | | | | | | | | | | | | | |
| X | | | | | | | | | | | | | | | | "T" shape |
| 5 | | | | | | | | | | | | | | | | |
| 6 | | | | | | | | | | | | | | | | |
| 7 | | | | | | | | | | | | | | | | |
| 8 | | | | | | | | | | | | | | | | 7/16 - 20 UNF |
| 9 | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | Pg13,5 |
| | | | | | | | | | | | | | | | | M20 x 1,5 |
| | | | | | | | | | | | | | | | | Pg13,5 |
| | | | | | | | | | | | | | | | | G 1/2 |
| | | | | | | | | | | | | | | | | 1/2 - 14 NPT |
| | | | | | | | | | | | | | | | | Pg13,5 |
| | | | | | | | | | | | | | | | | M20 x 1,5 |
| | | | | | | | | | | | | | | | | Pg13,5 |
| | | | | | | | | | | | | | | | | Range & Materials |
| | | | | | | | | | | | | | | | | Measuring ranges |
| | | | | | | | | | | | | | | | | Process cover |
| | | | | | | | | | | | | | | | | Diaphragm |
| | | | | | | | | | | | | | | | | Wetted cell body |
| | | | | | | | | | | | | | | | | SS 316L |
| | | | | | | | | | | | | | | | | Hastelloy C |
| | | | | | | | | | | | | | | | | Monel |
| | | | | | | | | | | | | | | | | Gold coat |
| | | | | | | | | | | | | | | | | Tantalum |
| | | | | | | | | | | | | | | | | Hastelloy C |
| | | | | | | | | | | | | | | | | Monel |
| | | | | | | | | | | | | | | | | Tantalum |
| | | | | | | | | | | | | | | | | SS 316L |
| | | | | | | | | | | | | | | | | Hastelloy C |
| | | | | | | | | | | | | | | | | Monel |
| | | | | | | | | | | | | | | | | Gold coat |
| | | | | | | | | | | | | | | | | Gold / ceramic |
| | | | | | | | | | | | | | | | | Tantalum |
| | | | | | | | | | | | | | | | | Hastelloy C |
| | | | | | | | | | | | | | | | | Monel |
| | | | | | | | | | | | | | | | | Tantalum |
| | | | | | | | | | | | | | | | | SS 316L |
| | | | | | | | | | | | | | | | | Hastelloy C |
| | | | | | | | | | | | | | | | | Monel |
| | | | | | | | | | | | | | | | | Gold coat |
| | | | | | | | | | | | | | | | | Gold / ceramic |
| | | | | | | | | | | | | | | | | Tantalum |
| | | | | | | | | | | | | | | | | Hastelloy C |
| | | | | | | | | | | | | | | | | Monel |
| | | | | | | | | | | | | | | | | Tantalum |
| | | | | | | | | | | | | | | | | SS 316L |
| | | | | | | | | | | | | | | | | Hastelloy C |
| | | | | | | | | | | | | | | | | Monel |
| | | | | | | | | | | | | | | | | Gold coat |
| | | | | | | | | | | | | | | | | Gold / ceramic |
| | | | | | | | | | | | | | | | | Tantalum |
| | | | | | | | | | | | | | | | | SS 316L |
| | | | | | | | | | | | | | | | | Hastelloy C |
| | | | | | | | | | | | | | | | | Gold coat |
| | | | | | | | | | | | | | | | | SS 316L |
| | | | | | | | | | | | | | | | | Indicator |
| | | | | | | | | | | | | | | | | Arrester |
| | | | | | | | | | | | | | | | | None |
| | | | | | | | | | | | | | | | | Analog, 0-100% linear scale |
| | | | | | | | | | | | | | | | | Analog, Custom scale |
| | | | | | | | | | | | | | | | | Analog, double scale |
| | | | | | | | | | | | | | | | | None |
| | | | | | | | | | | | | | | | | Analog, 0-100% linear scale |
| | | | | | | | | | | | | | | | | Analog, Custom scale |
| | | | | | | | | | | | | | | | | Analog, double scale |
| | | | | | | | | | | | | | | | | digital, 0-100% |
| | | | | | | | | | | | | | | | | digital, Custom scale |
| | | | | | | | | | | | | | | | | digital, 0-100% |
| | | | | | | | | | | | | | | | | digital, Custom scale |
| | | | | | | | | | | | | | | | | digital, 0-100% with push buttons |
| | | | | | | | | | | | | | | | | digital, Custom scale with push buttons |
| | | | | | | | | | | | | | | | | digital, 0-100% with push buttons |
| | | | | | | | | | | | | | | | | digital, Custom scale with push buttons |
| | | | | | | | | | | | | | | | | Hazardous location approvals |
| | | | | | | | | | | | | | | | | None |
| | | | | | | | | | | | | | | | | ATEX - Flameproof |
| | | | | | | | | | | | | | | | | ATEX - Intrinsic Safety |
| | | | | | | | | | | | | | | | | ATEX - Increased Safety |
| | | | | | | | | | | | | | | | | ATEX - Combination Flameproof and Intrinsic Safety |
| | | | | | | | | | | | | | | | | cCSAus - Explosion proof |
| | | | | | | | | | | | | | | | | cCSAus - Intrinsic Safety and Non Incendive |
| | | | | | | | | | | | | | | | | cCSAus - Combination Explosion proof, Intrinsic Safety and Non Incendive |
| | | | | | | | | | | | | | | | | IECEX - Flameproof |
| | | | | | | | | | | | | | | | | IECEX - Intrinsic Safety |
| | | | | | | | | | | | | | | | | IECEX - Increased Safety |
| | | | | | | | | | | | | | | | | IECEX - Combination Flameproof and Intrinsic Safety |
| | | | | | | | | | | | | | | | | IECEX - ATEX - cCSAus - Explosion/flameproof, Intrinsic Safety and Non Incendive |


[illegible]

Notes* :

- 1- M12 oval flange screws are required for pressure > 100 bar.
- 2- Turn down ratio of 100 is possible but span greater than 1/40 of the the URL is recommended for better performances.
- 3- Gold coating on wetted parts of the measuring cell for hydrogen service. Gold/ceramic coating available upon request.
- 4- Process cover with PVDF insert: 1/2"-14 NPT side process connection, no vent/drain, square section PTFE gasket. Other upon request
- 5- When no code can be found in the current model code, place "*" in the corresponding digit code as well as in the 16th digit.
- 6- SS 660 bolts/nuts are in conformity with NACE MR0175/ISO 15156 and must be used for NACE service
- 7- Only with digit 4 = "R", "T", "W", "6", "8"
- 8- Except digit 10 = "P", "Q"
- 9- SS 316L enclosure not available for "T" shape version

OUTLINE DIAGRAM (unit : mm)

<7th digit code : V, H, M, T>

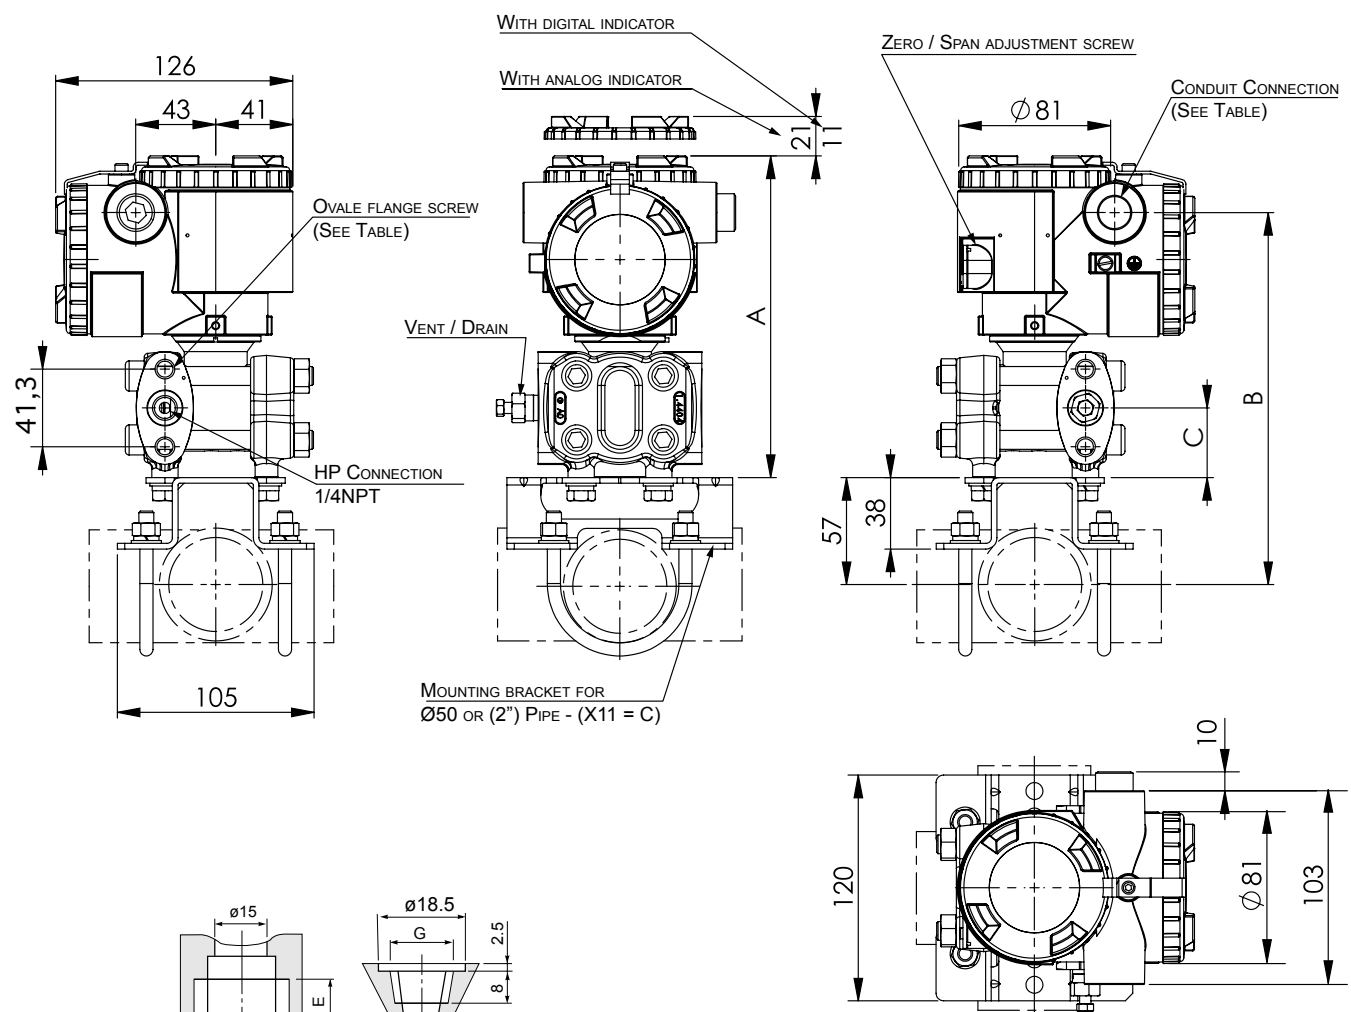

| CODE X=4 | CONDUIT CONNECTION | | OVAL FLANGE SCREW |
|----------|--------------------|------|-------------------|
| | D | E | G |
| R | M20x1.5 | 16 | 7/16-20 UNF |
| T | 1/2-14NPT | 16 | 7/16-20 UNF |
| V | Pg13.5 | 10,5 | M10 or M12 |
| W | M20x1.5 | 16 | M10 or M12 |
| X | Pg13.5 | 10,5 | 7/16-20 UNF |


TABLE

| DIMENSIONS | | | |
|------------|-------|-------|------|
| MODEL | A | B | C |
| FKG□01 | 171 | 198 | 37 |
| FKG□02 | | | |
| FKG□03 | | | |
| FKG□04 | | | |
| FKG□05 | 172,5 | 199,5 | 38,5 |

WEIGHT : - 3,5 KG (WITHOUT OPTION)
ADD : - 0,3 KG FOR INDICATOR OPTION
- 0,5 KG FOR MOUNTING BRACKET
- 2 KG FOR STAINLESS STEEL HOUSING OPTION

| X ₁ X ₂ X ₃ X ₄ X ₅ X ₆ X ₇ X ₈ -X ₉ X ₁₀ X ₁₁ X ₁₂ X ₁₃ - X ₁₄ X ₁₅ - X ₁₆ | | | | | | | | | | | | | | | | SPAN LIMIT | |
|---|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|-------------------|---------------------|
| F K G □ 0 □ □ 5 - □ □ □ □ □ □ - □ □ □ □ | | | | | | | | | | | | | | | | Min. | Max. |
| FKG□01 | | | | | | | | | | | | | | | | 1,3 KPa (13 mbar) | 130 KPa (1300 mbar) |
| FKG□02 | | | | | | | | | | | | | | | | 5 KPa (50 mbar) | 500 KPa (5 bar) |
| FKG□03 | | | | | | | | | | | | | | | | 30 KPa (0,3 bar) | 3 MPa (30 bar) |
| FKG□04 | | | | | | | | | | | | | | | | 100 KPa (1 bar) | 10 MPa (100 bar) |
| FKG□05 | | | | | | | | | | | | | | | | 500 KPa (5 bar) | 50 MPa (500 bar) |

CONNECTION DIAGRAM



ELECTROMAGNETIC COMPATIBILITY

All FCX-All series of pressure transmitters are in conformity with the provision of the EMC Directive 2014/30/EU on the harmonization of the laws of the Members States relating to electromagnetic compatibility.

All these models of pressure transmitters are in accordance with the following harmonized standards :

- **EN 61326-1** (*Electrical equipment for measurement, control and laboratory use - EMC requirements - Part 1: General requirements*).
- **EN 61326-2-3** (*Particular requirements - Test configuration, operational conditions and performance criteria for transducers with integrated or remote signal conditioning*).

Emission limits (according to EN 55011 / CISPR 11, Group 1 Class A)

| Frequency range (MHz) | Limits | Basic standard |
|-----------------------|--|----------------|
| 30 to 230 | 40 dB (μV/m) quasi peak, measured at 10 m distance | Passed |
| 230 to 1000 | 47 dB (μV/m) quasi peak, measured at 10 m distance | |

Immunity

| Phenomenon | Test value | Standard | Required Performance criteria | Result of criteria |
|---------------------------------|--|------------------|-------------------------------|--------------------|
| Electrostatic Discharge | ±4 kV (Contact) ±8 kV (Air) | EN/IEC 61000-4-2 | B | A |
| Radiated, Electromagnetic Field | 10 V/m (0.08 to 1.0 GHz) 3 V/m (1.4 to 2.0 GHz) 1 V/m (2.0 to 2.7 GHz) | EN/IEC 61000-4-3 | A | A |
| Fast transients (burst) | 2 kV (5/50 ns, 5 kHz) | EN/IEC 61000-4-4 | B | A |
| Surge Transients | 1 kV Line to line 2 kV Line to ground | EN/IEC 61000-4-5 | B | A |
| Conducted RF Disturbances | 3 Vrms (150 kHz to 80 MHz) 80% AM @ 1 kHz | EN/IEC 61000-4-6 | A | A |
| Power Frequency Magnetic Field | 30 A/m (50 Hz, 60 Hz) | EN/IEC 61000-4-8 | A | A |

Performance criteria (A & B): according to IEC 61326



Fuji Electric France S.A.S.

46 rue Georges Besse - ZI du brézet - 63039 Clermont ferrand

Tél : 04 73 98 26 98 - Fax : 04 73 98 26 99

Mail : sales.dpt@fujielectric.fr - web : www.fujielectric.fr

Fuji Electric can accept no responsibility for possible errors in catalogues, brochures and other printed material. Fuji Electric reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequential changes being necessary in specifications already agreed. All trademarks in this material are property of the respective companies. All rights reserved.